



# ASBESTOS CONTAINING MATERIAL INVESTIGATION REPORT

**I-26 BRIDGE OVER THE SALUDA RIVER  
RICHLAND/LEXINGTON COUNTY,  
SOUTH CAROLINA**

## PREPARED FOR:



Mr. David Kinard, P.E.  
Project Manager  
3955 Faber Place Drive, Suite 300  
North Charleston, South Carolina 29405

## PREPARED BY:

F&ME Consultants  
1825 Blanding Street  
Columbia, South Carolina 29201

**February 27, 2019**

Yes, asbestos was found.  
 No, asbestos was not found

F&ME Project No.: G5662.010

# TABLE OF CONTENTS

<b>1. Executive Summary .....</b>	<b>1</b>
<b>2. Introduction.....</b>	<b>1</b>
<b>3. Existing Bridge Structure .....</b>	<b>2</b>
<b>4. Field Assessment.....</b>	<b>3</b>
<b>5. Assessment Results .....</b>	<b>4</b>
<b>6. Recommendations .....</b>	<b>5</b>
<b>Appendices.....</b>	<b>7</b>

Appendix A – Site Vicinity Map

Appendix B – General Building Plans

Appendix C – Sample Location Plans

Appendix D – Homogeneous Area Plans

Appendix E – Summary of Samples

Appendix F – Summary of Asbestos Containing Materials

Appendix G – Summary of Inspection

Appendix H – Physical Assessment Data Sheets

Appendix I – Laboratory Analysis Reports

Appendix J – Chain of Custody Forms

Appendix K – Personnel Certifications

Appendix L – Regulatory Summary

Appendix M – Abatement Project Forms



## 1. EXECUTIVE SUMMARY

This executive summary is intended as an overview for the convenience of the reader. This report should be reviewed in its entirety prior to making any decisions regarding this project.

F&ME Consultants Inc. (F&ME) completed an Asbestos Containing Material (ACM) Investigation on the I-26 Bridge over the Saluda River in Richland/Lexington County, South Carolina, for HDR, Inc (David Kinard, P.E. - Project Manager), on February 14, 2019, and was also conducted pursuant to South Carolina Department of Health and Environmental Control (SCDHEC), United States Environmental Protection Agency (USEPA), National Emission Standards for Hazardous Air Pollutants (NESHAP), and Occupational Safety and Health Administration (OSHA) regulations requiring an ACM investigation prior to any demolition and/or renovation activities.

Per an agreed upon scope of work, F&ME performed this investigation to identify any ACM that might be encountered during the demolition of the existing bridge structure, and to provide recommendations regarding proper handling and disposal of any ACM found. The investigation of the subject bridge identified three (3) suspect materials: expansion joint board; black expansion joint material and Transite conduit attached to the underside of the bridge structure. During the field investigation, F&ME collected samples of the suspect materials and assessed the physical condition of each material. **Laboratory results indicated that the Transite conduit was the only material that contained asbestos.** During the demolition activities, previously concealed ACM may be discovered. If hidden suspect ACM is encountered, the affected contractor(s) must stop work, take appropriate actions, and notify the Owner/F&ME Consultants for an appropriate response action.

We appreciate the opportunity to assist you in this matter. If you have any questions or require additional information, please feel free to contact our office at (803) 254-4540.

Sincerely,

F&ME CONSULTANTS



**Michael S. Mincey**  
Environmental Professional  
Asbestos Consultant/Management Planner  
SCDHEC License No: MP-00161  
Expiration Date 01/21/2020



**Glynn M. Ellen**  
Environmental Department Manager  
Asbestos Consultant/Management Planner  
SCDHEC License No: ASB-22641  
Expiration Date 01/21/2020



## 2. INTRODUCTION

F&ME Consultants has completed an ACM investigation on the I-26 Bridge over the Saluda River in Richland/Lexington County, South Carolina. The investigation was performed on February 14, 2019. This investigation was conducted pursuant to SCDHEC, USEPA, NESHAP, and OSHA regulations which require an ACM investigation prior to any demolition and/or renovation activities. See Appendix A – Site Vicinity Map for the location of I-26 Bridge over the Saluda River.

It is our understanding that the existing bridge structure will to be demolished as part of the Carolina Crossroads Project. The scope of this investigation was to determine if asbestos was present on the existing bridge structure by identifying and sampling suspect ACM, obtaining analytical results, quantifying any confirmed ACM, and assessing the physical condition of the ACM, where possible.

This report has been prepared exclusively for HDR, Inc. and shall not be disseminated in whole or part to other parties without prior consent from HDR, Inc. or F&ME Consultants, Inc. No other environmental issues were addressed as part of this report.

## 3. EXISTING BRIDGE STRUCTURE

The existing bridge structure (~705.0'L x 116.0'W, inside curb to inside curb), is located on I-26 in Richland/Lexington County, South Carolina. The actual date of construction for the original bridge structure is unknown. The bridge was widened from it's original construction in the late 1980's. The structure is a six (6) lane bridge constructed with a poured-in-place concrete bridge deck, with concrete curb and gutters and consists of nine (9) bridge deck spans. The original bridge deck spans are supported by five (5) precast horizontal concrete beams and concrete diaphragms supported by concrete piers and poured in place concrete bent caps. The widened section of the bridge is supported by three (3) horizontal beams and concrete diaphragms supported by concrete piers. End bents are constructed with vertical concrete walls and wing walls and have soil and concrete covering the piles with only the top of the concrete bent cap exposed. Galvanized guardrails and posts are attached to both ends of the bridge structure. The bridge approach from both sides of the bridge consist of a six-lane asphalt paved roadway. Multiple communications and



*Photo 1 – I-26 Bridge over Saluda River in Richland/Lexington County, SC.*



utility lines were noted for communication lines attached to the underside of the bridge deck, along with six (6) 4" Transite Conduits.

## 4. FIELD ASSESSMENT

During the inspection, all bridge components (i.e. concrete bent caps, piles, and expansion joints) were visually inspected for suspect ACM. Examples of possible suspect materials include bent and pile cap felt, bond-break pads, expansion joint material, and Transite scuppers. The bridge deck rested directly on the pile and bent caps. An expansion joint board; black expansion joint material and Transite conduit were noted during the investigation and are suspect materials. Non- suspect PVC scuppers were observed on the sides of the bridge. See Appendix B – Sample Location Plan, for detailed sample locations. Also, see Appendix J – Site Photographs, for more details.

### 4.1 Suspect Materials

The purpose of this investigation was to locate, sample and record the physical characteristics of suspect ACM on the subject bridge structure. Therefore, the quantities and physical condition of suspect materials were assessed, and bulk samples of these materials were submitted for laboratory analysis. The following suspect materials and approximate amounts were identified during this ACM Investigation:

- Expansion Joint Board (<1,000 SF)
- Black Expansion Joint Material (<1,000 SF)
- Transite Conduit Piping (~4,230 LF)

Random samples of the suspect materials were collected for laboratory analysis, and their physical characteristics were recorded. Building materials such as concrete, metal, wood, brick, carpet, etc., were not considered suspect ACM. Bulk samples of suspect materials were analyzed by Polarized Light Microscopy (PLM) in accordance with EPA 600/R-93/116. Confirmation Transmission Electron Microscopy (TEM) was also performed on any non-friable organically bound materials that tested negative for asbestos content as per SCDHEC regulations effective May 27, 2011. See Appendix D – Summary of Samples, for complete list of all samples taken. See Appendix L–SCDHEC Regulation Summary. Proper sampling and chain-of-custody protocols were followed to ensure appropriate handling and delivery of samples to the analytical laboratory. Refer to Appendix K – Personnel Certifications, for SCDHEC qualifications of Investigation personnel, and Appendix I– Chain of Custody Forms, for documentation of proper handling and delivery of samples.



## 5. ASSESSMENT RESULTS

During the investigation, an expansion joint board; a black expansion joint material and Transite conduit were found associated with the bridge structure. Three (3) random samples of each suspect expansion joint materials, one (1) sample the known ACM material Transite, were collected for laboratory analysis, and their physical characteristics were recorded. The remaining structural materials (i.e. concrete, steel, etc.) were not considered suspect and were not sampled.

The samples of the suspect material were analyzed by polarized light microscopy (PLM) in accordance with EPA 600/R-93/116. A “*first positive stop*” protocol was utilized for this investigation. This protocol establishes that if the first sample of a material tested positive for asbestos content, subsequent samples were not to be analyzed, and would be considered positive as well. **Laboratory results indicated that the Transite conduit was the only material found to contain asbestos.** Results of laboratory analysis are summarized in Appendix D – Summary of Sample Results and Appendix E – Summary of Asbestos Containing Materials.

Appropriate sampling and chain-of-custody protocols were followed to ensure proper handling and delivery of samples to the analytical laboratory. Appendix H and I were provided to show laboratory documentation for the analytical results. Appendix K – Personnel Certification, shows the official qualifications of the South Carolina Asbestos Inspectors.

### 5.1 Homogeneous Area Locations Where ACM Was Identified

The following are photographs, descriptions, and approximate quantities of the ACM identified during the Investigation. Guidance is also provided for the proper handling and disposition if the materials in these areas are to be removed. See Appendix C – Homogeneous Area Plans, for homogeneous sampling areas for the various ACM identified below.

**HA-1 – Transite Communications Conduit (~4,230 LF).** ACM Transite conduit was found attached to the underside of the center section of the bridge. There are six (6) 4” conduit lines running the full length of the bridge. Overall, this material was intact with localized damage at the bents and one (1) broken section of conduit. At the end bents where the lines terminate, the material is in a friable condition and on the ground. Removal of these conduit lines may render the material friable depending on the means and methods utilized. This material must be abated prior to the start of demolition activities by a licensed abatement contractor.



## 6. RECOMMENDATIONS

The results, conclusions, and recommendations of this investigation are representative of the conditions observed at the site on the date of the field inspection. F&ME does not assume responsibility for any changes in conditions or circumstances that may have occurred after this inspection.

It is our understanding that the existing bridge structure will to be demolished as part of the Carolina Crossroads Project. Prior demolition activities, the Transite conduit found attached to the underside of the bridge structure must be removed, handled and disposed of per SCDHEC regulations pertaining to asbestos waste. Removal of these types of bridge components (i.e. Transite Conduit Piping) prior to demolition activities is practical, and will require coordination with a licensed abatement contractor. Based on the quantities and type of ACM identified, a written abatement project design will not be required if non-friable abatement methods are utilized. However, if it is determined that the Transite conduit can only be removed by friable methods, an abatement design by certified Abatement Project Designer prior to the commencement of abatement activities may be required.

If any concealed and/or inaccessible ACM are encountered during the demolition activities, the affected contractor(s) must stop work, take appropriate actions, and notify the Owner/asbestos Consultant for an appropriate response action. The SCDHEC must be notified if any suspect ACM is discovered.

All asbestos waste must be deposited in a landfill permitted by the SCDHEC for receiving ACM. If any concealed and/or inaccessible ACM is encountered during asbestos abatement or renovation activities, the affected contractor(s) must stop work, take appropriate actions, and notify the Owner/ Abatement Contractor/ Asbestos Consultant for an appropriate response action. The SCDHEC must be notified if any additional ACM is discovered, as well as changes in the condition of identified ACM.

The SCDHEC's Standards of Performance for Asbestos Projects (R 61-86.1) includes requirements for abatement projects regarding notifications, project design, air sampling and analysis, etc. For informational purposes, some of these requirements are summarized below:

*Notifications.* Written notification (SCDHEC Form 3430) must be submitted to SCDHEC at least two (2) calendar weeks prior to initiation of abatement activities for renovation/demolition projects. A copy of this inspection report and applicable fee payment must be attached to the notification. Additional fees may be required. Copies of all notifications and documents pertinent to the abatement operations must be posted on the job site during abatement work. The Owner/Operators must notify all parties involved with this project of the nature of the work as well as the locations and quantities of asbestos materials to be disturbed or those located near demolition/removal work areas. This notification requirement is also extended to any persons/employees who work near the demolition/removal work areas.



*Project Design.* Furthermore, abatement projects that will remove more than 3,000 square, 1,500 linear or 656 cubic feet of asbestos-containing materials are required to have a licensed and certified Abatement Project Designer develop a project design prior to the commencement of any abatement activities. The Abatement Contractor is required to adhere to the design, which must address all information as directed by the regulations.

*Air Monitoring.* The Abatement Contractor is responsible for daily personal air sampling for Abatement Workers in compliance with current OSHA standard 29 CFR 1926.1101. All remaining air monitoring services required for a renovation project (i.e. backgrounds, areas, and clearances) will be provided by the Owner or the Owner's Representative, as required by SCDHEC.

We sincerely appreciate the opportunity to be of service to HDR, Inc., in this matter. If you have any questions regarding the information presented herein, please contact our office at (803) 254-4540.





## APPENDICES

Appendix A – Site Vicinity Map

Appendix B – Sample Location Plan

Appendix C – Homogeneous Area Plan

Appendix D – Summary of Samples

Appendix E – Summary of Asbestos Containing Materials

Appendix F – Summary of Inspection

Appendix G – Physical Assessment Data Sheet

Appendix H – Laboratory Analysis Reports

Appendix I – Chain of Custody Form

Appendix J – Site Photographs


Appendix K – Personnel Certifications

Appendix L – Regulatory Summary

Appendix M – Abatement Project Forms




**Appendix A**  
**Site Vicinity Map**

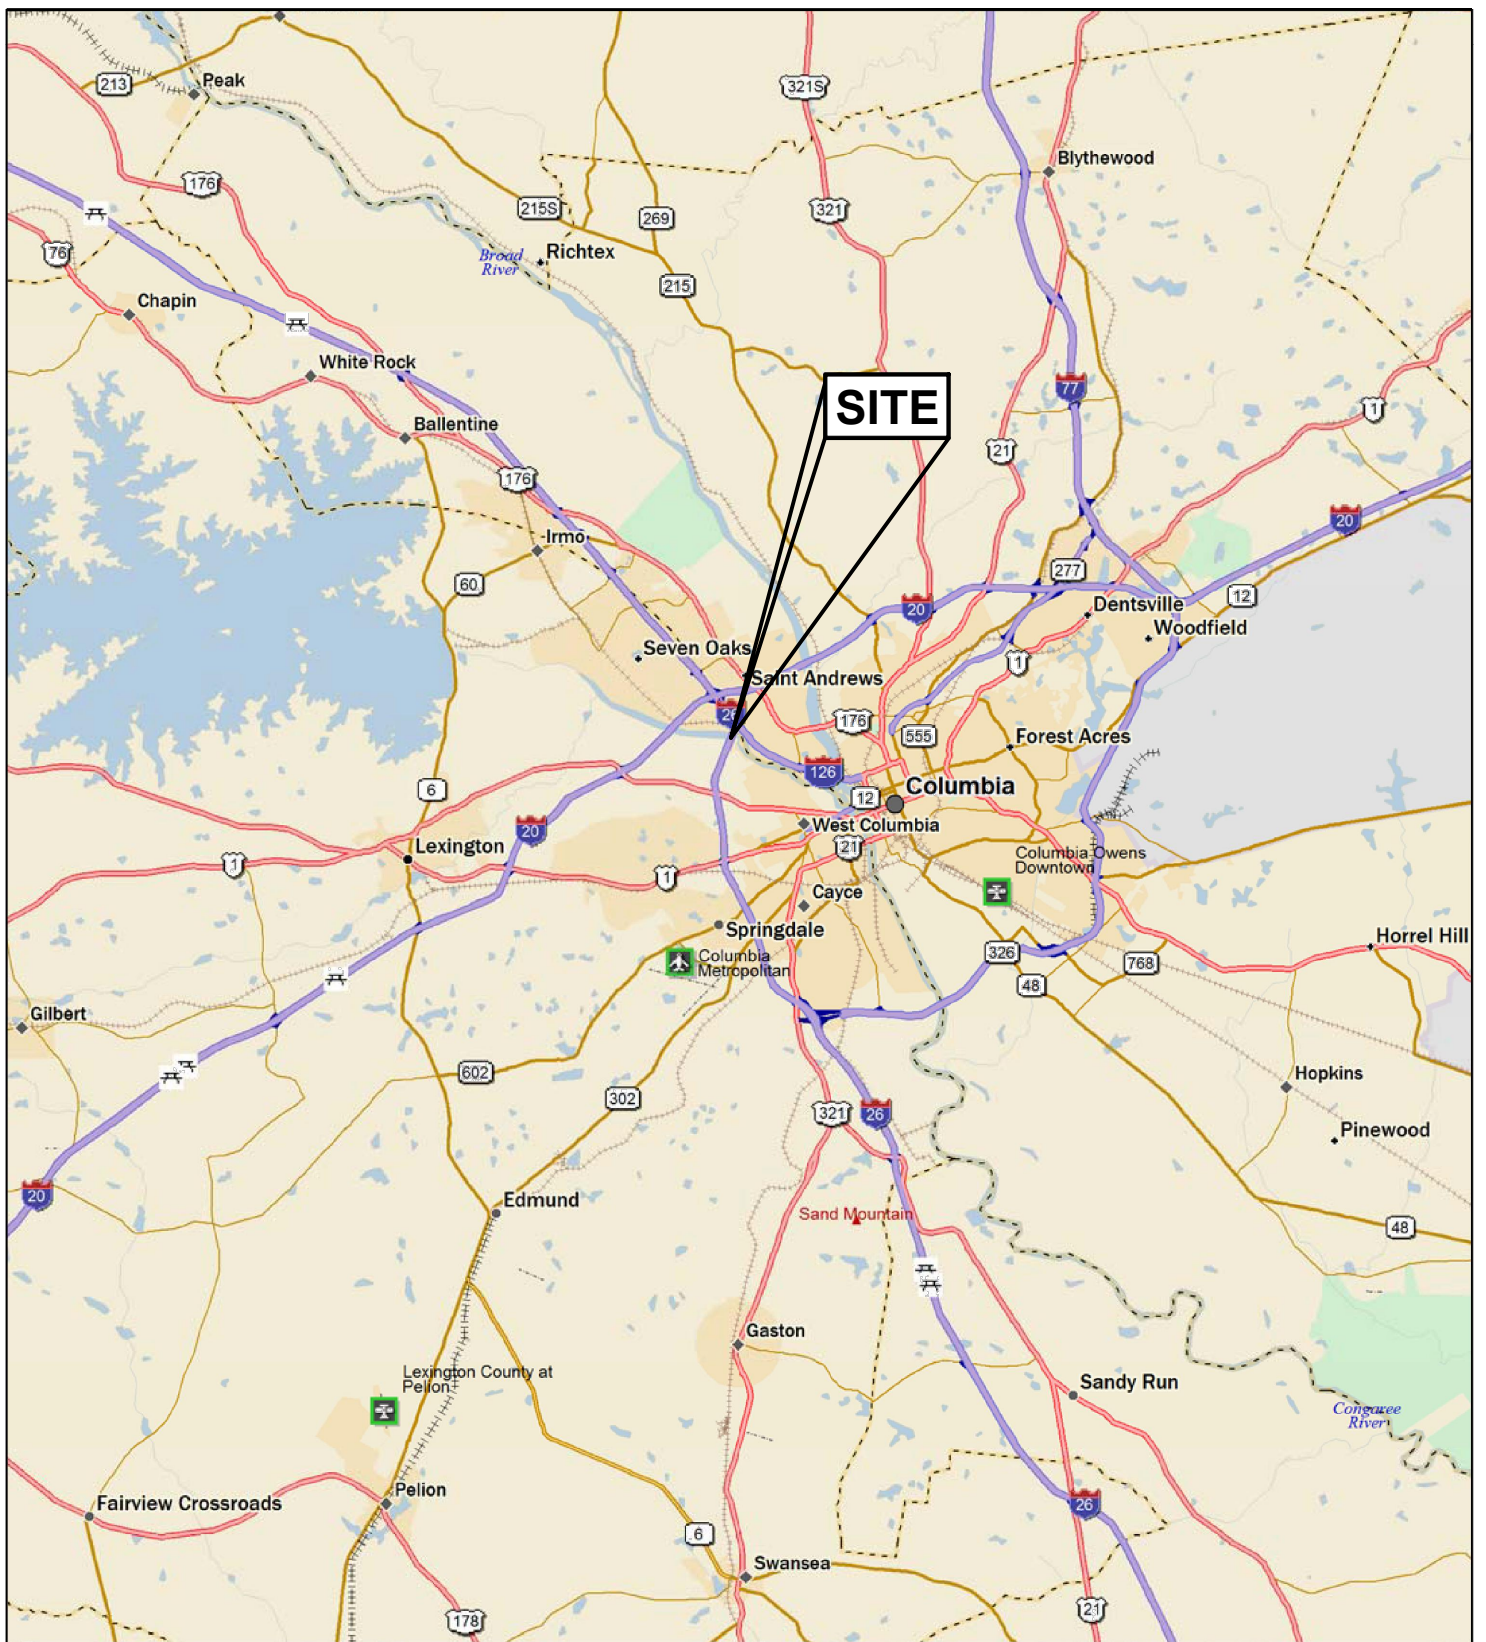


Data use subject to license.

© DeLorme. DeLorme Street Atlas USA® 2009.

www.delorme.com



Scale 1 : 300,000



1" = 4.73 mi Data Zoom 9-4

FIGURE NUMBER:

1

F&ME CONSULTANTS PROJECT NUMBER:

G5662.010

**ASBESTOS CONTAINING MATERIALS INVESTIGATION**  
**I-26 over the Saluda River**  
 Richland County, SC  
**Site Vicinity Map**

Prepared for: HDR, Inc.  
 3955 Faber Place Drive, Suite 300  
 North Charleston, SC 29405

**F&ME CONSULTANTS**

1825 Blanding Street  
 Columbia, SC 29201

ORIGINAL:  
 February 18, 2019

REVISIONS:

- 1
- 2
- 3

SCALE:  
 AS SHOWN

DRWN. BY: CTC  
 CHKD. BY: MSM  
 APPR. BY: GME

NOTES:


## Appendix B

### Sample Location Plan




## Appendix C

### Homogeneous Area Plan



HA-1 - Transite Conduit

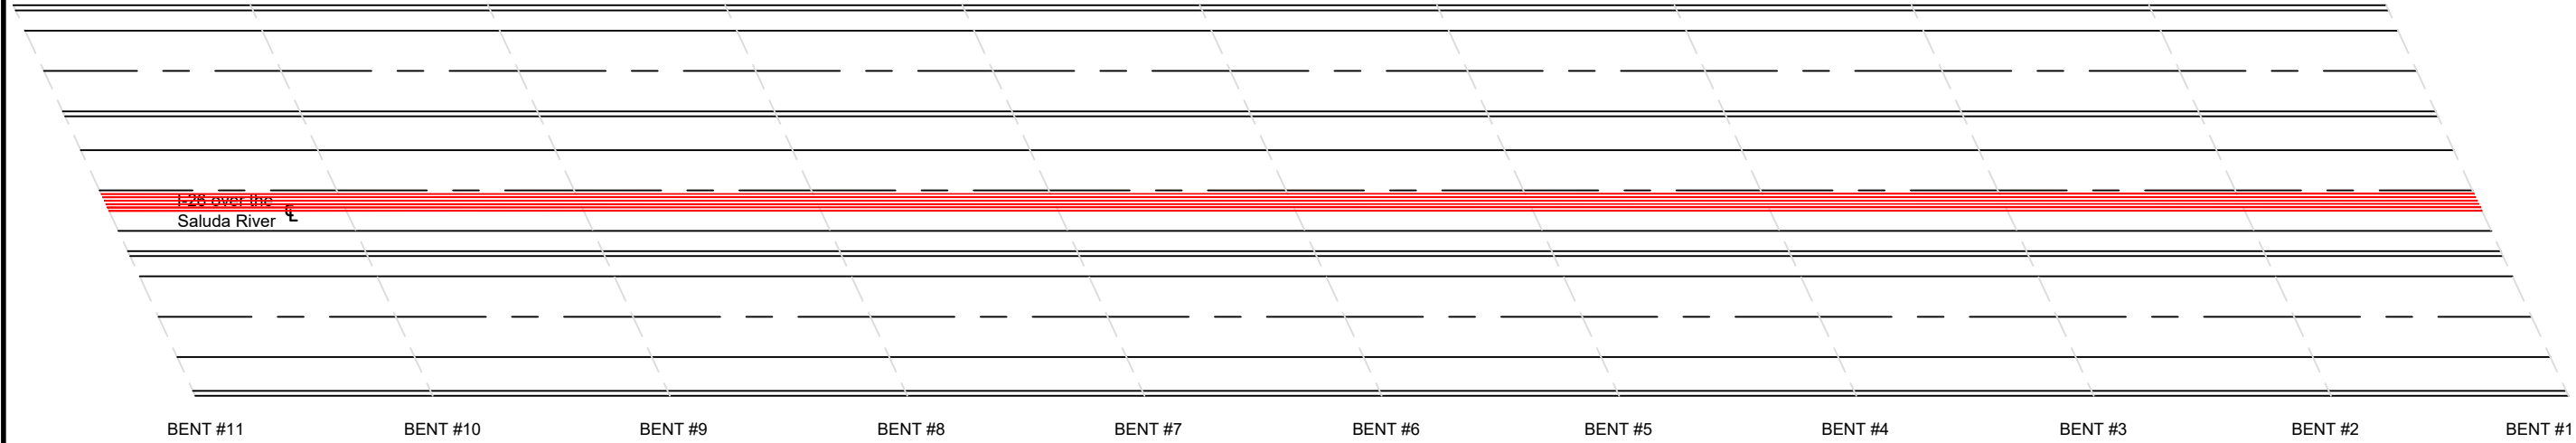

DRWN BY: MSM	ORIGINAL:
CHKD BY: MSM	February 18, 2019
APPR BY: GME	REVISIONS:
NOTES:	1
	2
	3
	SCALE
	N.T.S.

**F&ME**  
CONSULTANTS  
GEOTECHNICAL - ENVIRONMENTAL - MATERIALS  
2825 BLANDING STREET  
COLUMBIA, SC 29201

**ASBESTOS CONTAINING MATERIALS  
INVESTIGATION**  
**I-26 over the Saluda River**  
Richland County, SC  
**Homogeneous Area Plan**  
Prepared for: HDR, Inc.  
3955 Faber Place Drive, Suite 300  
North Charleston, SC 29405

F&ME CONSULTANTS  
PROJECT NUMBER:  
**G5662.010**

FIGURE NUMBER:  
**3**

## Appendix D

### Summary of Samples



## Appendix D: Summary of Samples

Sample ID	Description
I-26-1-1	Expansion Joint Board
I-26-1-2	Expansion Joint Board
I-26-1-3	Expansion Joint Board
I-26-2-1	Black Expansion Joint Material
I-26-2-2	Black Expansion Joint Material
I-26-2-3	Black Expansion Joint Material
I-26-3-1	Transite Conduit



## Appendix E

### Summary of Asbestos Containing Materials

## APPENDIX E: SUMMARY OF ASBESTOS CONTAINING MATERIALS

Sample ID	Sample Description	Layer	% Asbestos
I-26-3-1	Transite Conduit	-	19% Chrysotile 1% Crocidolite



## Appendix F

### Summary of Inspection

## SUMMARY OF INSPECTION

### SUMMARY OF INSPECTION

The following tables summarize the physical assessment data, sampling and assessment results.

As exhibited on these tables, coding is used to abbreviate the asbestos containing materials' (ACM) locations, characteristics and results. These codes are as follows:

#### TYPES OF ACM:

Misc. = Miscellaneous

Sur. = Surfacing

TSI = Thermal System Insulation

#### ACM LOCATIONS:

Homogeneous areas = Indicated by Roman Numerals, Room Number or Area Designation

<u>Functional Space No.:</u>	<u>Functional Space Type:</u>	
1.	UB	Under Bridge

#### ACM CHARACTERISTICS:

F = Friable

NF = Non-Friable

#### ASSESSMENT RESULTS:

(Refer to Physical Assessment Data)

#### POTENTIAL FOR DISTURBANCE:

(Refer to Physical Assessment Data)

## SUMMARY OF INSPECTION

### PHYSICAL ASSESSMENT CATAGORIES:

1. Damaged or significantly damaged friable thermal system insulation ACM.
2. Damaged friable surfacing ACM.
3. Significantly damaged friable surfacing ACM.
4. Damaged or significantly damaged friable miscellaneous ACM.
5. ACM with potential for significant damage.
6. ACM with potential for damage.
7. Any remaining friable ACM or friable suspect ACM.
8. Non-friable ACM.

### CLASSIFICATION FOR HAZARD POTENTIAL:

(Tabular Display)

<u>Hazard Rank</u>	<u>ACM Condition</u>	<u>ACM Disturbance Potential</u>
7	Significantly Damaged	Any
6	Damaged	Potential for Significant Damage
5	Damaged	Potential for Damage
4	Damaged	Low
3	Good	Potential for Significant Damage
2	Good	Potential for Damage
1	Good	Low

## Appendix G

### Physical Assessment Sheets

## PHYSICAL ASSESSMENT DATA SHEET

**Building:** I-26 Bridge over the Saluda River

**Functional Space No:** 1 **Type:** UB **Location:** (See Homogeneous Area Plan)

**Type of Suspect Material:** TSI **Surfacing** X **Misc.** \_\_\_\_\_

**Description:** HA-1, Transite Conduit

**Approximate Amount of Material (SF or LF):** ~4,230 LF

**Condition:**

**Percent Damage:** \_\_\_\_\_ >0% X <10% \_\_\_\_\_ >10% \_\_\_\_\_ <25% \_\_\_\_\_ >25%

**Extent of Damage:** X Localized \_\_\_\_\_ Distributed

**Type of Damage:** X Deterioration X Water X Physical

**Description:**

ACM Transite conduit was found attached to the underside of the center section of the bridge. There are six (6) 4" conduit lines running the full length of the bridge. Overall, this material was intact with localized damage at the bents and one (1) broken section of conduit. At the end bents where the lines terminate, the material is in a friable condition and on the ground.

**Overall Condition Rating:** Sig. Damaged \_\_\_\_\_ Damaged X Good \_\_\_\_\_

**Potential for Disturbance:**

	High	Moderate	Low	Friable ACM
Frequency of Potential Contact:	_____	_____	<u>X</u>	<u>X</u>
Influence of Vibration	_____	_____	<u>X</u>	<u>X</u>
Frequency of Air Erosion	_____	_____	<u>X</u>	<u>X</u>
Potential of Water Erosion	_____	_____	<u>X</u>	<u>X</u>

**Overall Potential Disturbance Rating:**

Potential for Sig. Damage	Potential for Damage	Low Potential for Damage
_____	_____	<u>4</u>

**Overall Hazard Rank #:**

Sig. Damaged	Pot. Sig. Damage	Potential Damage	Low Pot. Damage
_____	_____	_____	<u>4</u>

**Comments:** Potential for Disturbance and Hazard Ranking assessed is based on current usage of the facility.

**Signed:**  **Date:** 02/22/2019



## Appendix H

### Laboratory Analysis Reports



# EMSL Analytical, Inc.

706 Gralin Street Kernersville, NC 27284

Tel/Fax: (336) 992-1025 / (336) 992-4175

<http://www.EMSL.com> / [greensborolab@emsl.com](mailto:greensborolab@emsl.com)


<b>EMSL Order:</b> 021901170
<b>Customer ID:</b> FMEC62
<b>Customer PO:</b> G5662.01
<b>Project ID:</b>

<b>Attention:</b> Glynn M. Ellen F & ME Consultants 1825 Blanding Street Columbia, SC 29201	<b>Phone:</b> (803) 254-4540 <b>Fax:</b> (803) 254-4542 <b>Received Date:</b> 02/18/2019 9:00 AM <b>Analysis Date:</b> 02/20/2019 <b>Collected Date:</b> 02/15/2019
<b>Project:</b> ACM Inv. - I-26 Bridge over Saluda River	

## Test Report: Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 Method using Polarized Light Microscopy

Sample	Description	Appearance	Non-Asbestos		Asbestos
			% Fibrous	% Non-Fibrous	% Type
I-26-1-1 <small>021901170-0001</small>	Expansion Joint Board	Brown/Black Fibrous Homogeneous	2% Cellulose	98% Non-fibrous (Other)	None Detected
I-26-1-2 <small>021901170-0002</small>	Expansion Joint Board	Black Non-Fibrous Homogeneous	2% Cellulose	98% Non-fibrous (Other)	None Detected
I-26-2-1 <small>021901170-0003</small>	Black Expansion Joint Material	Brown/Black Fibrous Homogeneous	3% Cellulose 1% Synthetic 1% Hair	95% Non-fibrous (Other)	None Detected
I-26-2-2 <small>021901170-0004</small>	Black Expansion Joint Material	Brown/Black Non-Fibrous Homogeneous	2% Cellulose <1% Synthetic	98% Non-fibrous (Other)	None Detected
I-26-3-1 <small>021901170-0005</small>	Transite Conduit	Gray Fibrous Homogeneous		80% Non-fibrous (Other)	19% Chrysotile 1% Crocidolite

Analyst(s) \_\_\_\_\_  
 Kristie Elliott (3)  
 Nicole Shutts (2)

  
 \_\_\_\_\_  
 Stephen Bennett, Laboratory Manager  
 or Other Approved Signatory

EMSL maintains liability limited to cost of analysis. The above analyses were performed in general compliance with Appendix E to Subpart E of 40 CFR (previously EPA 600/M4-82-020 "Interim Method"), but augmented with procedures outlined in the 1993 ("final") version of the method. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. Interpretation and use of test results are the responsibility of the client. All samples received in acceptable condition unless otherwise noted. This report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST or any agency of the federal government. EMSL recommends gravimetric reduction for all non-friable organically bound materials prior to analysis. Estimation of uncertainty is available on request.

Samples analyzed by EMSL Analytical, Inc. Kernersville, NC NVLAP Lab Code 102104-0, CA ELAP 2689, Virginia 3333-000228, West Virginia LT000321

Initial report from: 02/20/2019 13:49:36



# EMSL Analytical, Inc.

706 Gralin Street Kernersville, NC 27284  
Tel/Fax: (336) 992-1025 / (336) 992-4175  
<http://www.EMSL.com> / [greensborolab@emsl.com](mailto:greensborolab@emsl.com)

**EMSL Order:** 021901170  
**Customer ID:** FMEC62  
**Customer PO:** G5662.01  
**Project ID:**

**Attention:** Glynn M. Ellen  
F & ME Consultants  
1825 Blanding Street  
Columbia, SC 29201  
**Phone:** (803) 254-4540  
**Fax:** (803) 254-4542  
**Received Date:** 02/18/2019 9:00 AM  
**Analysis Date:** 02/21/2019  
**Collected Date:** 02/15/2019  
**Project:** ACM Inv. - I-26 Bridge over Saluda River

## Test Report: Asbestos Analysis of Non-Friable Organically Bound Materials by TEM via EPA/600/R-93/116 Section 2.5.5.1

Sample ID	Description	Appearance	% Matrix Material	% Non-Asbestos Fibers	Asbestos Types
1-26-1-3 021901170-0006	Expansion Joint Board	Brown/Black Non-Fibrous Homogeneous	100.0 Other	None	No Asbestos Detected
1-26-2-3 021901170-0007	Black Expansion Joint Material	Brown/Black Non-Fibrous Homogeneous	100.0 Other	None	No Asbestos Detected

Analyst(s)

Stephen Bennett (2)

Stephen Bennett, Laboratory Manager  
or other approved signatory

This laboratory is not responsible for % asbestos in total sample when the residue only is submitted for analysis. The above report relates only to the items tested. This report may not be reproduced, except in full, without written approval by EMSL Analytical, Inc. Samples received in good condition unless otherwise noted. Unless requested by the client, building materials manufactured with multiple layers (i.e. linoleum, wallboard, etc.) are reported as a single sample.

Samples analyzed by EMSL Analytical, Inc. Kernersville, NC

Initial report from: 02/21/2019 14:26:57

## Appendix I

### Chain of Custody Form



EMSL ANALYTICAL, INC.  
LABORATORY • PRODUCTS • TRAINING

# Asbestos Chain of Custody

EMSL Order Number (Lab Use Only):

1170

EMSL ANALYTICAL, INC.  
706 GRALIN ST.  
KERNERSVILLE, NC 27284  
PHONE: (336) 992-1025  
FAX: (336) 992-4175

Company Name : F&ME Consultants		EMSL Customer ID: FMEC62	
Street: 3112 Devine Street		City: Columbia	State/Province: SC
Zip/Postal Code: 29205	Country: USA	Telephone #: 803-254-4540	Fax #: 803-254-4542
Report To (Name):		Please Provide Results: <input type="checkbox"/> Fax <input checked="" type="checkbox"/> Email	
Email Address: gellen@fmeconsultants.com; mmmincey@fmeconsultants.com		Purchase Order: G5662.01	
Project Name/Number: ACM Inv. - I-26 Bridge over Saluda River		EMSL Project ID (Internal Use Only):	
U.S. State Samples Taken: SC		CT Samples: <input type="checkbox"/> Commercial/Taxable <input type="checkbox"/> Residential/Tax Exempt	

EMSL-Bill to:  Same  Different - If Bill to is Different note instructions in Comments\*\*  
Third Party Billing requires written authorization from third party

**Turnaround Time (TAT) Options\* - Please Check**

3 Hour  6 Hour  24 Hour  48 Hour  72 Hour  96 Hour  1 Week  2 Week

\*For TEM Air 3 hr through 6 hr, please call ahead to schedule. \*There is a premium charge for 3 Hour TEM AHERA or EPA Level II TAT. You will be asked to sign an authorization form for this service. Analysis completed in accordance with EMSL's Terms and Conditions located in the Analytical Price Guide.

<p><b>PCM - Air</b> <input type="checkbox"/> Check if samples are from NY</p> <p><input type="checkbox"/> NIOSH 7400</p> <p><input type="checkbox"/> w/ OSHA 8hr. TWA</p> <p><b>PLM - Bulk (reporting limit)</b></p> <p><input checked="" type="checkbox"/> PLM EPA 600/R-93/116 (&lt;1%)</p> <p><input type="checkbox"/> PLM EPA NOB (&lt;1%)</p> <p>Point Count</p> <p><input type="checkbox"/> 400 (&lt;0.25%) <input type="checkbox"/> 1000 (&lt;0.1%)</p> <p>Point Count w/Gravimetric</p> <p><input type="checkbox"/> 400 (&lt;0.25%) <input type="checkbox"/> 1000 (&lt;0.1%)</p> <p><input type="checkbox"/> NYS 198.1 (friable in NY)</p> <p><input type="checkbox"/> NYS 198.6 NOB (non-friable-NY)</p> <p><input type="checkbox"/> NYS 198.8 SOF-V</p> <p><input type="checkbox"/> NIOSH 9002 (&lt;1%)</p>	<p><b>TEM - Air</b> <input type="checkbox"/> 4-4.5hr TAT (AHERA only)</p> <p><input type="checkbox"/> AHERA 40 CFR, Part 763</p> <p><input type="checkbox"/> NIOSH 7402</p> <p><input type="checkbox"/> EPA Level II</p> <p><input type="checkbox"/> ISO 10312</p> <p><b>TEM - Bulk</b></p> <p><input checked="" type="checkbox"/> TEM EPA NOB</p> <p><input type="checkbox"/> NYS NOB 198.4 (non-friable-NY)</p> <p><input type="checkbox"/> Chatfield SOP</p> <p><input type="checkbox"/> TEM Mass Analysis-EPA 600 sec. 2.5</p> <p><b>TEM - Water:</b> EPA 100.2</p> <p>Fibers &gt;10µm <input type="checkbox"/> Waste <input type="checkbox"/> Drinking</p> <p>All Fiber Sizes <input type="checkbox"/> Waste <input type="checkbox"/> Drinking</p>	<p><b>TEM- Dust</b></p> <p><input type="checkbox"/> Microvac - ASTM D 5755</p> <p><input type="checkbox"/> Wipe - ASTM D6480</p> <p><input type="checkbox"/> Carpet Sonication (EPA 600/J-93/167)</p> <p><b>Soil/Rock/Vermiculite</b></p> <p><input type="checkbox"/> PLM EPA 600/R-93/116 with milling prep (&lt;1%)</p> <p><input type="checkbox"/> PLM EPA 600/R-93/116 with milling prep (&lt;0.25%)</p> <p><input type="checkbox"/> TEM EPA 600/R-93/116 with milling prep (&lt;0.1%)</p> <p><input type="checkbox"/> TEM Qualitative via Filtration Prep</p> <p><input type="checkbox"/> TEM Qualitative via Drop Mount Prep</p> <p><input type="checkbox"/> Cincinnati Method EPA 600/R-04/004 - PLM/TEM (BC only)</p> <p><b>Other:</b></p> <p><input type="checkbox"/></p>
---	---	--

Check For Positive Stop - Clearly Identify Homogenous Group      Filter Pore Size (Air Samples):  0.8µm  0.45µm

Samplers Name: Mike Mincey

Samplers Signature: *Mike Mincey*

Sample #	Sample Description	Volume/Area (Air) HA # (Bulk)	Date/Time Sampled
*I-26-1-1 to I-26-1-3	Expansion Joint Board		
*I-26-2-1 to I-26-2-3	Black Expansion Joint Material		
I-26-3-1	Transite Conduit		

Client Sample # (s):	I-26-1-1 - I-26-3-1	Total # of Samples:	7
Relinquished (Client):	<i>Mike Mincey</i>	Date:	02/15/2019
Received (Lab):	<i>[Signature]</i>	Date:	2/18/19
Comments/Special Instructions:	Samples marked with astrick (*), run TEM only.		
<i>Ⓢ EFV 795680306604</i>			

## Appendix J

### Site Photographs

APPENDIX J - SITE PHOTOGRAPHS



Photo 1. East Side View of Bridge.



Photo 2. Top of Bridge Deck View.



Photo 3. Expansion Joint Board



Photo 4. Black Expansion Joint Material



Photo 5. Transite Conduit

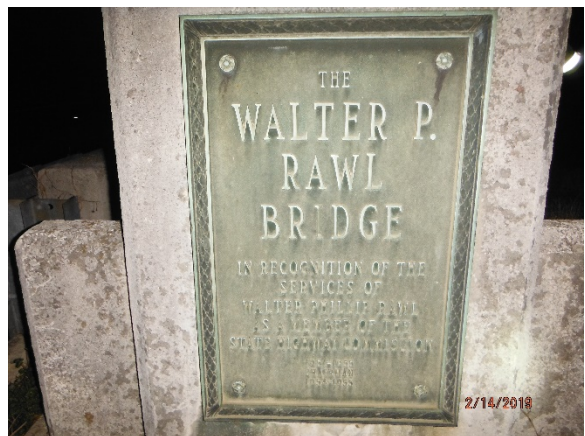


Photo 6. Plaque on Bridge



## Appendix K

### Personnel Certifications



# SCDHEC ISSUED

## Asbestos ID Card

---

**Michael Mincey**



		Expiration Date:
<b>CONSULTMP</b>	<b>MP-00161</b>	<b>01/21/20</b>
<b>AIRSAMPLER</b>	<b>AS-00272</b>	<b>01/22/20</b>
<b>SUPERAHERA</b>	<b>SA-01424</b>	<b>01/22/20</b>

This card is nontransferable and considered invalid if loaned or given to another person for identification. This card will also be invalid if altered or defaced. This card is property of SCDHEC. It must be returned to the department if the holder's accreditation is revoked or if this card is invalidated. Any person performing regulated asbestos activities without current accreditation shall be subject to legal sanction. This card must be returned upon expiration and/or issuance of a new card.

**YOU MUST HAVE THIS IDENTIFICATION CARD WITH YOU ON THE JOB.**

For information of corrections contact: SCDHEC – Asbestos Section  
2600 Bull Street  
Columbia, SC 29201  
(803) 898-4289

# SCDHEC ISSUED

## Asbestos ID Card

**Glynn M Ellen**



		Expiration Date:
<b>SUPERAHERA</b>	<b>SA-00455</b>	<b>01/22/20</b>
<b>AIRSAMPLER</b>	<b>AS-00079</b>	<b>01/22/20</b>
<b>CONSULTPD</b>	<b>PD-00098</b>	<b>06/08/19</b>
<b>CONSULTMP</b>	<b>ASB-22641</b>	<b>01/21/20</b>

This card is nontransferable and becomes invalid if loaned or given to another person for identification. This card will also be invalid if altered or defaced. This card is property of SCDHEC. It must be returned to the department if the holder's accreditation is revoked or if this card is invalidated. Any person performing regulated asbestos activities without current accreditation shall be subject to legal sanction. This card must be returned upon expiration and/or issuance of a new card.

**YOU MUST HAVE THIS IDENTIFICATION CARD WITH YOU ON THE JOB.**

For information of corrections contact: SCDHEC – Asbestos Section  
2600 Bull Street  
Columbia, SC 29201  
(803) 898-4289

**Appendix L**  
**Regulatory Summary**

# **Asbestos Regulatory Information**

## **Renovations & Demolitions**

### **Definitions**

**Renovation** means altering a facility or one or more facility components in any way, including the stripping or removal of regulated asbestos-containing materials (RACM) from a facility component. "Remodeling" is considered renovation.

**Demolition** is wrecking or taking out any load-supporting structural member of a facility together and any related handling operations. Structural burns are prohibited by State Open Burning Regulations.

### **Applicability**

Renovation and demolition of most facilities (including buildings, structures, and other installations), are subject to State and Federal asbestos regulations. Certain residential buildings may be exempt. Contact the SCDHEC Asbestos Section for additional information.

All asbestos-containing materials must be removed from a facility prior to demolition. Only the following asbestos-containing materials (ACM) may be left in place during demolition:

- ACM on a facility component that is encased in concrete or other similarly hard material and is adequately wet whenever exposed during demolition
- RACM that was not accessible for testing and was, therefore, not discovered until after demolition began and, as a result of the demolition, cannot be safely removed. If not removed for safety reasons, all exposed RACM and any asbestos-contaminated debris must be treated as regulated asbestos-containing waste material. Category I and Category II non-friable mastic, glue, and adhesive ACM that is not friable or in poor condition, and where the probability is low that the materials will become crumbled, pulverized, or reduced to powder during demolition operations.
- Category I and Category II non-friable mastic, glue, and adhesive ACM that is not friable or in poor condition, and where the probability is low that the materials will become crumbled, pulverized, or reduced to powder during demolition operations.

**The facility owner and the renovation or demolition contractor are both responsible for ensuring compliance with these regulations.**

## **Building Inspections**

Before a facility or a portion of a facility is renovated or demolished, the owner/operator of the facility or renovation or demolition activity must ensure that the facility or portion of the facility being renovated or demolished has been thoroughly inspected for the presence of asbestos. The inspection must be performed by a person who has been trained and licensed as an Asbestos Building Inspector or management planner in accordance with State training and licensing requirements.

The inspector must identify, quantify, and assess the condition of all suspect asbestos-containing material, either friable or non-friable, on interior and exterior portions of the facility. The inspector must also comply with the procedures specified in Regulation 61-86.1 VI D. In addition, the inspector is required to prepare a written report detailing the findings of the inspection. At a minimum, the report must include information required in Regulation 61-86.1 VI C. A legible copy of the building inspection report must be provided to the Department prior to each demolition, and upon request for renovations. (**Note: " BUILDING INSPECTIONS "can be consulted for a detailed explanation of the aforementioned sampling and reporting protocols.**)

A building inspection will only be acceptable if performed **within three years** prior to the demolition or renovation. If an inspection report is more than three years old, then it must be confirmed and verified by a licensed Asbestos Building Inspector or Management Planner.

### **Friable Asbestos Containing Materials**

If friable asbestos-containing materials (e.g., pipe insulation) are present, they must be removed prior to being disturbed during renovation or demolition activities. Removal (abatement) must be performed by trained, licensed persons using procedures detailed in State and Federal regulations.

A project design must be prepared for each asbestos abatement project involving the abatement of greater than 3,000 square feet, 1,500 linear feet and/or 656 cubic feet of RACM in a facility to be reoccupied. Such designs must be prepared by a person licensed by DHEC as an Asbestos Project Designer.

### **Non-Friable Asbestos Containing Materials**

Please note that when it can reasonably be expected that non-friable materials will become friable during removal, that these materials must be considered friable from the beginning. If non-friable Asbestos Containing Materials (ACM) becomes friable during an abatement project, the removal becomes subject to the same requirements as friable materials, including training, licensing, notification, and work practices.

- Material should always be lowered to the ground carefully. Throwing or dropping non-friable ACM to the ground or into a truck will cause the material to become friable.
- Materials should be kept wet or misted with water during removal to minimize potential fiber release. **NOTE: The use of water is only a control measure and by no means prevents a material from becoming friable.**
- Once removed, materials may be placed in 6-mil polyethylene bags or drums or wrapped with 6-mil polyethylene sheeting. Additional water may be added to ensure thorough wetting, but do not add so much that the bag or wrapping breaks when lifted.
- Debris already on the ground should be wet and either collected manually or gathered with a shovel and bagged for disposal. These materials can be potential sources of airborne asbestos fiber releases.
- South Carolina Regulation 61-86.1 requires that containers (bags, drums, wrapped components) holding asbestos waste must be labeled with the following: **DANGER -**

**CONTAINS ASBESTOS FIBERS - AVOID CREATING DUST - CANCER AND LUNG DISEASE HAZARD.**

- Materials should be taken to a landfill as soon as possible but may be stored temporarily in a secure area subject to Departmental approval. Transport the materials so as to prevent them from leaking, spilling, or blowing off the vehicle.
- You should contact the landfill directly to make sure it will accept the material. You must obtain written approval from DHEC in advance for the disposal. You can get this approval by writing to the following address:

**South Carolina Department of Health and Environmental Control  
Attn: Bureau of Air Quality/Asbestos Section  
2600 Bull Street Columbia, SC 29201**

Be sure to include the following:

1. the address where the material is to be removed;
2. a brief description of the content (cement-like tiles, asphaltic shingles, etc.);
3. the volume of waste in cubic yards or the area in square feet of material removed, and;
4. the name and location of the landfill which has agreed to accept the waste.

*Please remember to include your name, return address, and phone number.*

- **DO NOT BURN OR RECYCLE** any asbestos-containing or asbestos-contaminated materials.

The Occupational Safety and Health Administration (OSHA) has rules for workers affected by asbestos-containing materials. These rules must be complied with by all contractors and facility owners and include specific work practices, respiratory protection, and asbestos training requirements, **even for activities involving only non-friable asbestos-containing materials**. Contact the Department of Labor at (803) 896-7665 for details.

## **Notification of Renovations & Demolitions**

Prior to removing regulated asbestos-containing materials, [written notification](#) must be submitted to DHEC (up to 10 working days in advance, depending on the amount of asbestos to be removed). The notification must include certain required items of information about the owner, the contractor, the facility, and the asbestos removal project. Required fees must be submitted along with the notification. You must obtain a permit from the Department prior to the renovation activity.

Prior to the demolition of any regulated facility, [written notification](#) must be submitted to DHEC *at least 10 working days* in advance **even if a building inspector determines that asbestos is not present at the facility**. The notification must include certain required items of information about the owner, the contractor, the facility, and the demolition project. Required fees and a copy of the building inspector's report must be submitted along with the notification of demolition. You must obtain a permit from the Department prior to the demolition activity.

## Disposal

*Never burn any asbestos-containing waste material.*

Non-asbestos-containing demolition debris and debris which contains only non-regulated roofing or flooring may be disposed of at a DHEC-approved disposal site for cellulosic or inert waste. Waste consolidation activities involving grinding, cutting, or compacting of non-friable asbestos-containing materials will subject these materials to more stringent State and Federal asbestos disposal regulations.

Regulated asbestos waste must be handled by properly licensed asbestos abatement personnel and disposed of at a landfill permitted to accept regulated asbestos waste. A list of approved landfills may be obtained from the Asbestos Section.

## Building Inspection Report Directions

As required by the National Emission Standard for Hazardous Air Pollutants (NESHAP) and Regulation 61-86.1, an owner/operator shall ensure that a building inspection, to detect the presence of asbestos-containing material (ACM), has been performed prior to any renovation or demolition activity at a regulated facility.

Under Regulation 61-86.1, Section VI.A.6., an inspection cannot have been performed more than three years prior to a renovation or demolition activity. If more than three years have elapsed since the most recent inspection, the previous inspection shall be confirmed and verified by a licensed building inspector and/or management planner.

Regulation 61-86.1 requires that all inspections be performed by persons trained and licensed as either a building inspector and/or management planner. In order to be licensed in these disciplines, persons must have successfully completed a DHEC approved initial training course specific to inspecting for ACM in a building and/or a course specific to management planning for ACM in a building. Persons must also have taken and passed an examination at the end of the course with a score of 70 percent or above.

In performing inspections, Regulation 61-86.1 requires that a building inspector and/or management planner comply with the requirements of Section VI, Asbestos Building Inspection Requirements. An inspection shall include samples from suspect friable and non-friable ACM on interior and exterior portions of a facility or its facility components.

In performing inspections, Regulation 61-86.1 requires that a building inspector and/or management planner follow specific sampling procedures. According to Section IV.B.3.a of the regulation, a building inspector and/or management planner shall comply with the procedures specified in **40 CFR 763.86** in determining sampling locations and the number of representative samples to be collected. An inspection shall include samples from suspect friable and non-friable ACM on interior and exterior portions of a facility or its facility components.

Under 40 CFR Part 763.86, suspect ACM are divided into three categories: surfacing materials, thermal system insulation (commonly referred to as TSI), and miscellaneous materials.

Regulation 61-86.1, Section VI contains sampling procedures specific to each category of material.

**Surfacing material** includes, but is not limited to, joint compound, plaster, and painted, troweled on, or spray-applied textured material. To remain in compliance with Regulation 61-86.1, surfacing materials on exterior and interior portions of a facility shall be sampled according to procedures outlined in Regulation 61-86.1, Section VI.D.1. (a)-(c):

- A licensed asbestos inspector shall collect, in a statistically random manner, a minimum of three bulk samples from each homogeneous area of any surfacing that is not assumed to be ACM, and shall collect the samples as follows:
  - At least three bulk samples shall be collected from each homogeneous area that is 1,000 or fewer square feet (sf) or linear feet (Lf) in size.
  - At least five bulk samples shall be collected from each homogeneous area that is greater than 1,000 but fewer than or equal to 5,000 sf or Lf.
  - At least seven bulk samples shall be collected from each homogeneous area that is greater than 5,000 sf or Lf.

**Thermal System Insulation (TSI)** is any material that is applied to pipes, fittings, boilers, breeching, tanks, ducts, or other facility components for the purpose of preventing heat loss or gain, water condensation, or for other purposes. **Miscellaneous Material** is any material that is not considered a surfacing material or thermal system insulation and includes, but is not limited to, flooring, roofing, mastics, gaskets, cementitious materials, caulking, ceiling tiles, fire doors, wall boards, and flexible duct connections. To remain in compliance with Regulation 61-86.1, TSI and miscellaneous materials on exterior and interior portions of a facility shall be sampled in accordance with procedures outlined in Regulation 61-86.1, Section VI.D.2:

- A licensed asbestos inspector shall collect, in a statistically random manner, at least three bulk samples from each homogeneous area of TSI and any miscellaneous material that is not assumed to be ACM.
- In accordance with ASTM E2356, and any subsequent amendments and editions, negative results for non-friable organically bound material (NOB) shall be verified with at least one TEM analysis.
- NOBs include flooring, roofing, mastics, adhesives, caulks, and glazing.
- If an accredited inspector has determined the thermal system insulation to be fiberglass, foam glass, rubber, or other non-suspect material, then bulk samples are not required.

**Regulation 61-86.1, Section VI.C requires that a building inspector and/or management planner prepare a written asbestos building inspection report to include the following:**

- A title page denoting:
  1. The client's name, company, address, and telephone number, and the name and exact location of the facility inspected;
  2. the date the inspection was performed;
  3. the date the inspection report was written; and
  4. the printed name and telephone number of the inspector(s), and his or her affiliated company name, address, and telephone number.



- A cover letter to the building owner or owner's representative that describes the purpose of the inspection; a general synopsis of the inspection and results; and the name, title, and signature of the inspector(s) and report writer, if different.
- A detailed narrative of the physical description of the building or part of the building affected by the renovation or demolition operation that includes:
  1. The square footage of the building or part of the building affected by the renovation or demolition operation;
  2. The building materials used in the construction of the exterior, roof, interior, and basement or crawlspace of the building affected by the demolition or affected by the renovation materials operation;
  3. An estimated or exact quantity (square or linear feet) for all suspect materials whether sampled for or assumed to be asbestos that may be affected by the renovation or demolition operation;
  4. Also include a description of non-suspect materials excluding: glass, metals, kiln brick, cement, fiberglass, concrete, pressed wood, cinder block, and rubber.
- An executive summary that details:
  1. The type of suspect ACM (e.g., TSI, floor tile, mastic), total square or linear footage, and the total number of samples collected for each separate homogenous area affected by the renovation or demolition operation;
  2. The date of the inspection, type, condition, quantity, sample results, and exact location of ACM positively identified or assumed to be ACM in the part of the building affected by the renovation or demolition operation;
  3. A list of the homogeneous areas identified;
  4. Whether the material is accessible for the building or part of the building affected by the renovation or demolition operation; and (5) The material's potential for disturbance for the building or part of the building affected by the renovation or demolition operation.
- For renovation and demolition operations, the inspector's determination that ACM is friable or non-friable.
- Except when suspect ACM materials are assumed to be asbestos, include a complete, clear, legible copy of all laboratory bulk sample results.
- Clear, legible drawings and/or photographs to clarify the scope of the renovation or demolition operation. Illustrate the exact location of each sample collected. For facilities that involve a trade secret or confidential component or an affected area process, a request for a variance may be submitted.
- The printed name and signature of each accredited inspector who collected the samples, and a clear legible copy of his or her DHEC issued asbestos building inspector or management planner license.

### **Things to Note:**

- At no time will negative assumptions about a suspect material's content be acceptable. There are only two acceptable options:
  1. Positive assumptions of suspect materials or
  2. Sampling of suspect materials per the procedures specified in 40 CFR 763.86
- A homogenous area is considered not to contain ACM only if the results of all samples required to be collected from the area are one percent or less.
- Bulk samples shall not be composited for analysis.

- In a multi-unit building, each separate room in each part of the building or areas affected by the renovation or demolition operation shall be inspected to confirm and quantify ACM homogeneous areas for sampling purposes.
- DHEC will not accept an asbestos building inspection or written report for any structure from an employee of an abatement company also involved in the removal of asbestos-containing materials from that structure, unless the licensed inspector is an employee of an entity regulated under Regulation 61-86.1, Section XX, Industrial Manufacturing and Electrical Generation Facilities.
- An asbestos building inspector shall not participate in the analysis of the bulk samples he or she has collected.
- Destructive sampling techniques shall be utilized.
- Material Safety Data Sheets (MSDS), statements from the manufacturer, and architecture signoff will not be accepted as proof that a building product contains no asbestos, except in cases where the owner can verify the direct correlation of the building product to the MSDS, statements from the manufacturer, and/or architecture signoff documents. DHEC reserves the right to reject documentation that it deems unacceptable.

## Appendix M

### Abatement Project Forms



**ASBESTOS ABATEMENT PROJECT LICENSE APPLICATION**  
 BUREAU OF AIR QUALITY • ASBESTOS SECTION • 2600 BULL STREET • COLUMBIA • SC • 29201

TYPE OF OPERATION:  Standard Removal  Emergency Removal  Enclosure  Encapsulation  Cleanup  Disposal

FOR OFFICE USE Postmark/Received: _____	Original <input type="checkbox"/> / Revised <input type="checkbox"/> / Cancellation <input type="checkbox"/> (check one)	Project License I.D. (For Revisions/Cancellations): _____
--	--	---

I. FACILITY OWNER: \_\_\_\_\_  
 MAILING ADDRESS: \_\_\_\_\_  
 CITY: \_\_\_\_\_ STATE: \_\_\_\_\_ ZIP: \_\_\_\_\_  
 CONTACT PERSON: \_\_\_\_\_ PHONE: (\_\_\_\_) \_\_\_\_\_

II. REMOVAL CONTRACTOR: \_\_\_\_\_  
 MAILING ADDRESS: \_\_\_\_\_  
 CITY: \_\_\_\_\_ STATE: \_\_\_\_\_ ZIP: \_\_\_\_\_  
 CONTACT PERSON: \_\_\_\_\_ PHONE: (\_\_\_\_) \_\_\_\_\_  
 E-MAIL ADDRESS: \_\_\_\_\_ E-MAIL PERMIT  OR MAIL PERMIT   
 FEDERAL I.D. NUMBER: \_\_\_\_\_  
 DHEC CONTRACTOR LICENSE NO. (If applicable): \_\_\_\_\_ EXPIRATION DATE: \_\_\_\_\_

III. FACILITY NAME: \_\_\_\_\_  
 STREET ADDRESS: \_\_\_\_\_  
 CITY: \_\_\_\_\_ STATE: \_\_\_\_\_ COUNTY: \_\_\_\_\_  
 SITE (ROOM, FLOOR, WING, UNIT, MACHINE, ETC.): \_\_\_\_\_  
 BUILDING SIZE: \_\_\_\_\_ NO. OF FLOORS: \_\_\_\_\_ AGE IN YEARS: \_\_\_\_\_  
 PRESENT USE: \_\_\_\_\_ PRIOR USE: \_\_\_\_\_ FUTURE USE: \_\_\_\_\_

IV. PROCEDURES, INCLUDING ANALYTICAL METHOD IF APPROPRIATE, USED TO DETECT THE PRESENCE OF ASBESTOS MATERIAL:  
 FACILITY OR FACILITY COMPONENT SURVEYED BY (INSPECTOR NAME): \_\_\_\_\_  
 COMPANY: \_\_\_\_\_ PHONE: (\_\_\_\_) \_\_\_\_\_  
 DHEC LICENSE NUMBER: \_\_\_\_\_ EXPIRATION DATE: \_\_\_\_\_

V. PROJECT DESIGN PERFORMED BY (IF APPLICABLE): \_\_\_\_\_  
 COMPANY: \_\_\_\_\_ PHONE: (\_\_\_\_) \_\_\_\_\_  
 DHEC LICENSE NUMBER: \_\_\_\_\_ EXPIRATION DATE: \_\_\_\_\_

VI. ASBESTOS-CONTAINING MATERIALS (ACM) **TO BE REMOVED ONLY:**

TYPE (TSI, SURFACING, FLOORING, ROOFING, ETC.)	AMOUNT (SQUARE FEET, LINEAR FEET, CUBIC FEET)	CONDITION (CIRCLE ONE)
		<input type="checkbox"/> FRIABLE <input type="checkbox"/> NON-FRIABLE
		<input type="checkbox"/> FRIABLE <input type="checkbox"/> NON-FRIABLE
		<input type="checkbox"/> FRIABLE <input type="checkbox"/> NON-FRIABLE
		<input type="checkbox"/> FRIABLE <input type="checkbox"/> NON-FRIABLE

VII. SCHEDULED DATES OF REMOVAL: START DATE: \_\_\_\_\_ COMPLETION DATE: \_\_\_\_\_  
 WORK DAYS: \_\_\_\_\_ WORK HOURS: \_\_\_\_\_

<p><b>APPLICATIONS MUST BE SUBMITTED WITH FEES PRIOR TO THE SCHEDULED START DATE AS FOLLOWS:</b>          NESHAP PROJECTS: 10 WORKING DAYS          SMALL PROJECTS: 4 WORKING DAYS          MINOR PROJECTS: 2 WORKING DAYS</p> <p>Non-Friable (NESAP-sized) Projects: 4 working days. No fee for non-friable ACM.</p> <p>For additional information concerning regulatory requirements call or visit our Web site at <a href="http://www.scdhec.gov/environment/baq/asbestos.aspx">http://www.scdhec.gov/environment/baq/asbestos.aspx</a></p>	<p><b>FEE SCHEDULE FOR FRIABLE ASBESTOS-CONTAINING MATERIALS:</b>          10 CENTS PER SQUARE FOOT OR LINEAR FOOT          MINIMUM FEE OF \$25.00          MAXIMUM FEE OF \$1000.00</p>
--	--

VIII. DESCRIPTION OF PLANNED ABATEMENT WORK & METHOD(S) TO BE USED:

IX. DESCRIPTION OF WORK PRACTICES & ENGINEERING CONTROLS TO BE USED TO PREVENT EMISSIONS OF ASBESTOS AT THE RENOVATION SITE:

X. WASTE TRANSPORTER #1: \_\_\_\_\_

MAILING ADDRESS: \_\_\_\_\_

CITY: \_\_\_\_\_ STATE: \_\_\_\_\_ ZIP: \_\_\_\_\_

CONTACT PERSON: \_\_\_\_\_ PHONE: (\_\_\_\_\_) \_\_\_\_\_

WASTE TRANSPORTER #2: \_\_\_\_\_

MAILING ADDRESS: \_\_\_\_\_

CITY: \_\_\_\_\_ STATE: \_\_\_\_\_ ZIP: \_\_\_\_\_

CONTACT PERSON: \_\_\_\_\_ PHONE: (\_\_\_\_\_) \_\_\_\_\_

XI. WASTE DISPOSAL SITE: \_\_\_\_\_

MAILING ADDRESS: \_\_\_\_\_

CITY: \_\_\_\_\_ STATE: \_\_\_\_\_ ZIP: \_\_\_\_\_

CONTACT PERSON: \_\_\_\_\_ PHONE: (\_\_\_\_\_) \_\_\_\_\_

TEMPORARY ASBESTOS STORAGE CONTAINMENT AREA LICENSE NUMBER (IF APPLICABLE): \_\_\_\_\_

XII. DESCRIPTION OF EMERGENCY REMOVAL (PLEASE ATTACH A LETTER FROM THE FACILITY OWNER EXPLAINING THE NATURE OF THE EMERGENCY)

DATE & HOUR OF EMERGENCY (MM/DD/YY): \_\_\_\_\_

DESCRIPTION OF SUDDEN, UNEXPECTED EVENT:

EXPLANATION OF HOW THE EVENT CAUSED UNSAFE CONDITIONS AND/OR WOULD CAUSE EQUIPMENT DAMAGE AND/OR AN UNREASONABLE FINANCIAL BURDEN:

XIII. DESCRIPTION OF PROCEDURES TO BE FOLLOWED IN THE EVENT THAT UNEXPECTED ASBESTOS IS FOUND OR PREVIOUSLY NON-FRIABLE ASBESTOS MATERIAL BECOMES CRUMBLD, PULVERIZED OR REDUCED TO POWDER:

XIV. I CERTIFY THAT AN INDIVIDUAL TRAINED IN THE PROVISIONS OF REGULATION (40 CFR PART 61, SUBPART M) WILL BE ON-SITE DURING THE RENOVATION AND EVIDENCE THAT THE REQUIRED TRAINING HAS BEEN ACCOMPLISHED BY THIS PERSON WILL BE AVAILABLE FOR INSPECTION DURING NORMAL BUSINESS HOURS.

\_\_\_\_\_  
(SIGNATURE OF OWNER/OPERATOR)

\_\_\_\_\_  
(DATE)

XIV. I CERTIFY THAT THE ABOVE INFORMATION IS CORRECT.

\_\_\_\_\_  
(SIGNATURE OF OWNER/OPERATOR)

\_\_\_\_\_  
(DATE)



**DEMOLITION LICENSE APPLICATION**

BUREAU OF AIR QUALITY • ASBESTOS SECTION • 2600 BULL STREET • COLUMBIA • SC • 29201

TYPE OF OPERATION:  Total Demolition  Partial Demolition  Ordered Demolition

FOR OFFICE USE

Postmark/Received: \_\_\_\_\_

Original/Revised/Cancellation (circle one)

Project License I.D. (For Revisions/Cancellations): \_\_\_\_\_

I. FACILITY OWNER: \_\_\_\_\_  
MAILING ADDRESS: \_\_\_\_\_  
CITY: \_\_\_\_\_ STATE: \_\_\_\_\_ ZIP: \_\_\_\_\_  
CONTACT PERSON: \_\_\_\_\_ PHONE: (\_\_\_\_) \_\_\_\_\_

II. IS ASBESTOS PRESENT IN THE FACILITY?: YES  / NO  (check one)

III. DEMOLITION CONTRACTOR: \_\_\_\_\_ FEDERAL ID NO.: \_\_\_\_\_  
MAILING ADDRESS: \_\_\_\_\_  
CITY: \_\_\_\_\_ STATE: \_\_\_\_\_ ZIP: \_\_\_\_\_  
CONTACT PERSON: \_\_\_\_\_ PHONE: (\_\_\_\_) \_\_\_\_\_  
E-MAIL ADDRESS: \_\_\_\_\_ E-MAIL PERMIT  OR MAIL PERMIT   
FEDERAL I.D. NUMBER: \_\_\_\_\_  
ASBESTOS REMOVAL CONTRACTOR (If applicable): \_\_\_\_\_  
MAILING ADDRESS: \_\_\_\_\_  
CITY: \_\_\_\_\_ STATE: \_\_\_\_\_ ZIP: \_\_\_\_\_  
CONTACT PERSON: \_\_\_\_\_ PHONE: (\_\_\_\_) \_\_\_\_\_

IV. FACILITY NAME: \_\_\_\_\_  
STREET ADDRESS: \_\_\_\_\_  
CITY: \_\_\_\_\_ STATE: \_\_\_\_\_ COUNTY: \_\_\_\_\_  
SITE (ROOM, FLOOR, WING, UNIT, MACHINE, ETC.): \_\_\_\_\_  
BUILDING SIZE: \_\_\_\_\_ NO. OF FLOORS: \_\_\_\_\_ AGE IN YEARS: \_\_\_\_\_  
PRESENT USE: \_\_\_\_\_ PRIOR USE: \_\_\_\_\_ FUTURE USE: \_\_\_\_\_

V. PROCEDURES, INCLUDING ANALYTICAL METHOD IF APPROPRIATE, USED TO DETECT THE PRESENCE OF ASBESTOS MATERIAL:  
FACILITY OR FACILITY COMPONENT SURVEYED BY (INSPECTOR NAME): \_\_\_\_\_  
COMPANY: \_\_\_\_\_ PHONE: (\_\_\_\_) \_\_\_\_\_  
DHEC LICENSE NUMBER: \_\_\_\_\_ EXPIRATION DATE: \_\_\_\_\_

VI. NON-FRIABLE MASTIC, GLUE, AND ADHESIVE ASBESTOS-CONTAINING MATERIALS **REMAINING IN PLACE DURING DEMOLITION** (IF APPLICABLE):

TYPE (MASTIC, GLUE, AND ADHESIVE)	AMOUNT (SQUARE FEET)

VII. SCHEDULED DATES OF DEMOLITION (YOU MUST SPECIFY DATES):  
START DATE: \_\_\_\_\_ COMPLETION DATE: \_\_\_\_\_  
WORK DAYS: \_\_\_\_\_ WORK HOURS: \_\_\_\_\_

- **Applications must be mailed along with a \$50.00 fee (payable to SCDHEC) at least 10 working days prior to the scheduled start date. Faxes will not be accepted.**
- **A copy of an asbestos survey report (no older than 3 years) must accompany the application.**

For additional information concerning regulatory requirements call or visit our Web site at <http://www.scdhec.gov/environment/baq/asbestos.aspx>

VIII. DESCRIPTION OF PLANNED DEMOLITION METHOD(S) TO BE USED:

BULLDOZER       LOADER       WRECKING BALL       MANUAL       BURNING       IMPLOSION/EXPLOSION

IF OTHER PLEASE DESCRIBE:

IX. DESCRIPTION OF WORK PRACTICES & ENGINEERING CONTROLS TO BE USED TO PREVENT EMISSIONS OF ASBESTOS AT THE DEMOLITION SITE:

X. WASTE TRANSPORTER #1: \_\_\_\_\_

MAILING ADDRESS: \_\_\_\_\_

CITY: \_\_\_\_\_ STATE: \_\_\_\_\_ ZIP: \_\_\_\_\_

CONTACT PERSON: \_\_\_\_\_ PHONE: (\_\_\_\_) \_\_\_\_\_

WASTE TRANSPORTER #2: \_\_\_\_\_

MAILING ADDRESS: \_\_\_\_\_

CITY: \_\_\_\_\_ STATE: \_\_\_\_\_ ZIP: \_\_\_\_\_

CONTACT PERSON: \_\_\_\_\_ PHONE: (\_\_\_\_) \_\_\_\_\_

XI. WASTE DISPOSAL SITE: \_\_\_\_\_

MAILING ADDRESS: \_\_\_\_\_

CITY: \_\_\_\_\_ STATE: \_\_\_\_\_ ZIP: \_\_\_\_\_

CONTACT PERSON: \_\_\_\_\_ PHONE: (\_\_\_\_) \_\_\_\_\_

XII. IF DEMOLITION ORDERED BY GOVERNMENT AGENCY, PLEASE IDENTIFY THE AGENCY BELOW: (PLEASE ATTACH A COPY OF THE ORDER)

NAME: \_\_\_\_\_ TITLE: \_\_\_\_\_

AUTHORITY: \_\_\_\_\_

DATE OF ORDER (MM/DD/YY): \_\_\_\_\_ DATE ORDERED TO BEGIN(MM/DD/YY): \_\_\_\_\_

XIII. DESCRIPTION OF PROCEDURES TO BE FOLLOWED IN THE EVENT THAT UNEXPECTED ASBESTOS IS FOUND OR PREVIOUSLY NONFRIABLE ASBESTOS MATERIAL BECOMES CRUMBLLED, PULVERIZED, OR REDUCED TO POWDER:

XIV. I CERTIFY THAT AN INDIVIDUAL TRAINED IN THE PROVISIONS OF REGULATION (40 CFR PART 61, SUBPART M) WILL BE ON-SITE DURING THE DEMOLITION INVOLVING RACM AND EVIDENCE THAT THE REQUIRED TRAINING HAS BEEN ACCOMPLISHED BY THIS PERSON WILL BE AVAILABLE FOR INSPECTION DURING NORMAL BUSINESS HOURS.

\_\_\_\_\_  
(SIGNATURE OF OWNER/OPERATOR)

\_\_\_\_\_  
(DATE)

XV. I CERTIFY THAT THE ABOVE INFORMATION IS CORRECT.

\_\_\_\_\_  
(SIGNATURE OF OWNER/OPERATOR)

\_\_\_\_\_  
(DATE)

- **Applications must be mailed along with a \$50.00 fee (payable to SCDHEC) at least 10 working days prior to the scheduled start date. Faxes will not be accepted.**
- **A copy of an asbestos survey report (no older than 3 years) must accompany the application.**

For additional information concerning regulatory requirements call or visit our Web site at <http://www.scdhec.gov/environment/baq/asbestos.aspx>

